

www.hzthv.com



式试验变压器

使用说明书

RTCQ

3

3

3

5

5

5

5

6

10


SF6

300KV


V	200	200	400	400	400	400
KV	50	100	150	200	250	300
pc	≤ 3	≤ 3	≤ 3	≤ 5	≤ 10	≤ 10
%	≤ 8	≤ 6	≤ 5	≤ 5	≤ 5	≤ 5
%	≤ 6	≤ 6	≤ 5	≤ 5	≤ 5	≤ 5
%	<3	<3	<3	<3	<3	<3

RTCQ

1 RTCQ

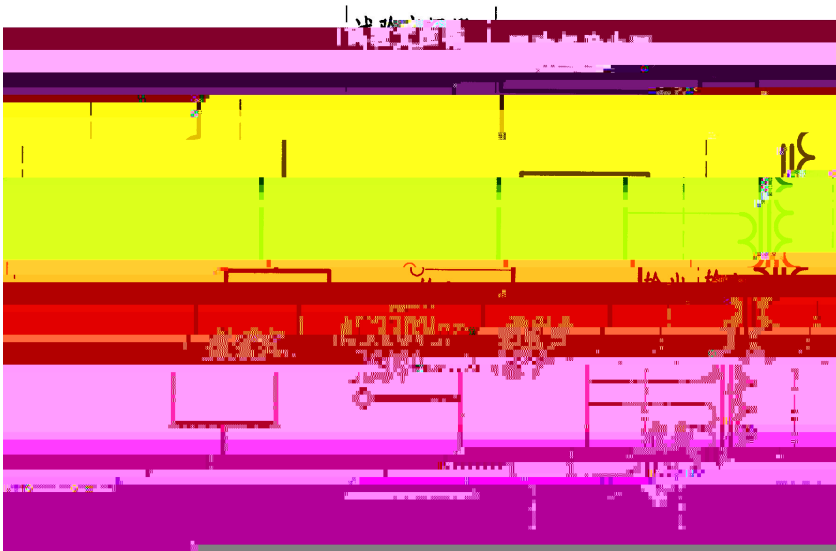

2 RTCQ

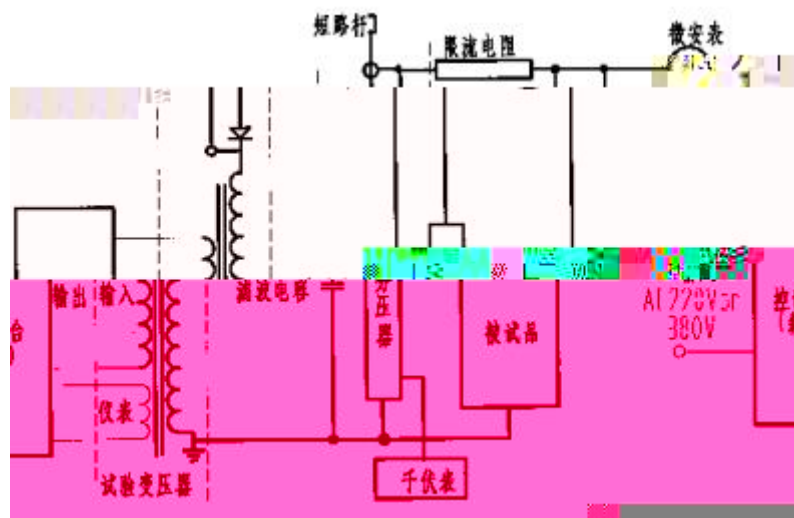


DT-9205


AC200V

DC200V

RTCQ C

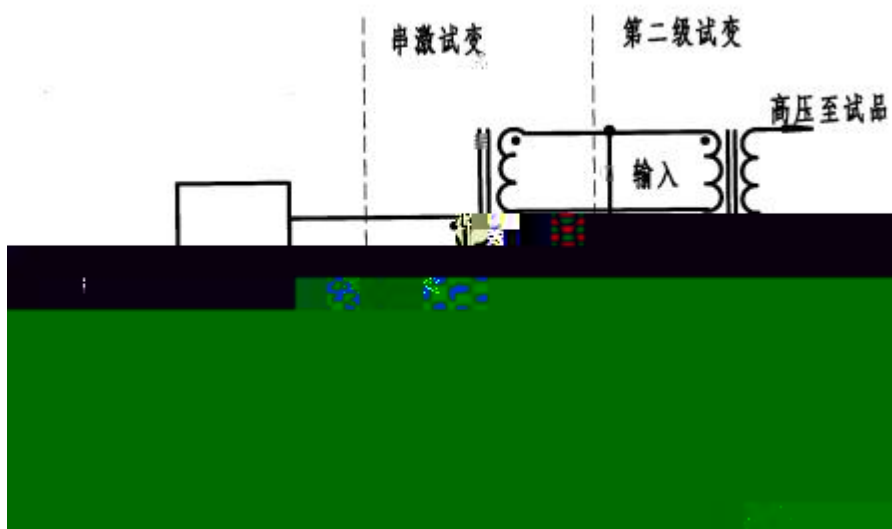

RTCQ

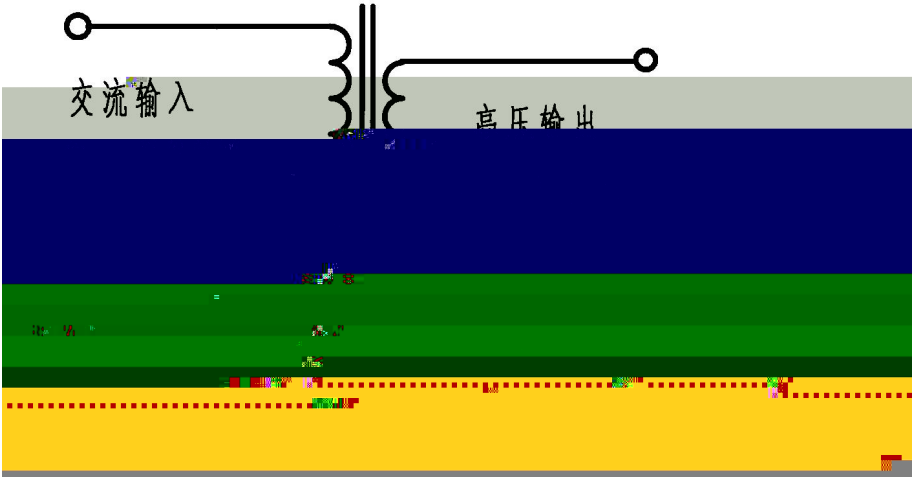

A
B
C
D
E
F


50kVA
220V 380V

1

1


BH -
KV -

A -
T -

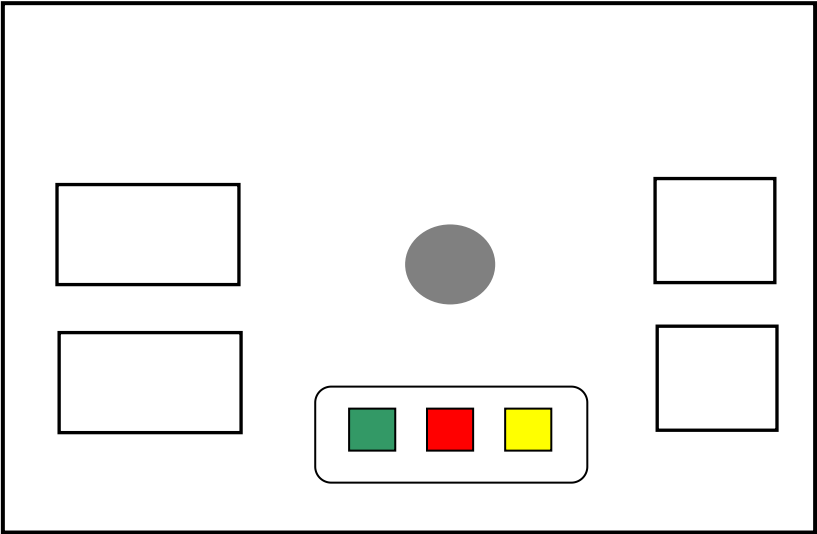

1—
3—
5—
7—

2—
4—
6—
8—

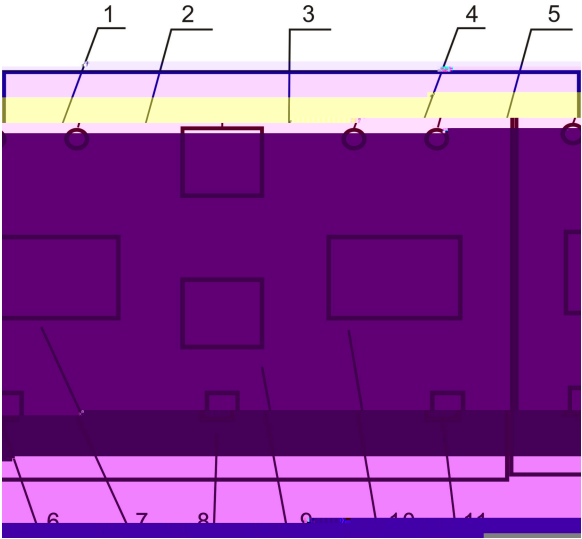

3

1—
4—
7—
10—

2—
5—
8—
11—

3—
6—
9—

6

30min

“DL474.4-92

= - E

Q S 7 4 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

6—1

6—2

500V

0.5MΩ

6—3

6—4

80%

6—5

7—1

0—40

7—2

1000m

7—3

85%

7—4

